


EM=374

LCMS Scan ESI-

Ret. Time: 3.11

<<<< NEGATIVE SPECTRA >>>>

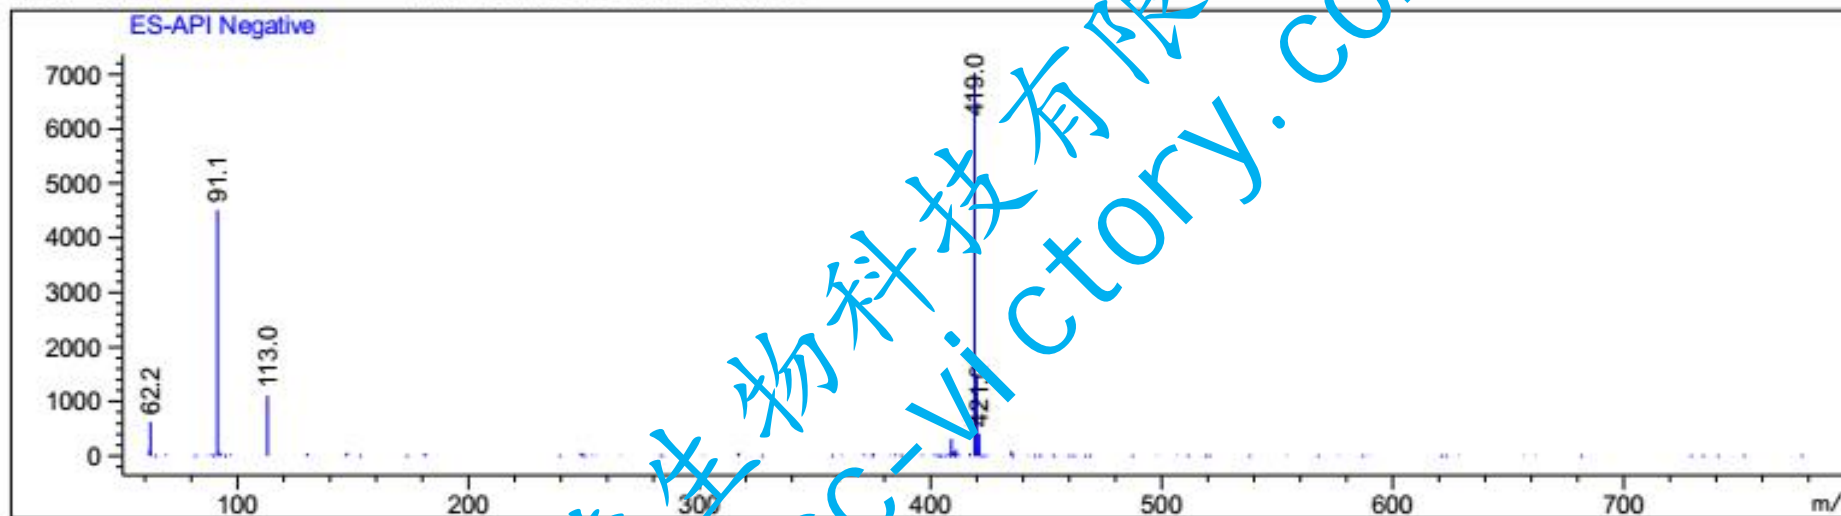

成都普菲德生物科技有限公司
<http://www.sc-victory.com>